




บริษัทกระดาศสหไทยไทย

- The machine is Turbine/Generator.
- The existing system is Shinakawa, but only at NDE Turbine.
- Some existing cards were failed and the spare parts are very high cost, moreover, they need to monitor whole Turbine locations as well.
- AST awarded to replace the failed existing system as well as installing a new system for whole Turbine locations.
- The new system is Rockwell Protection System which is certified API 670, the only standard for Turbine Vibration Protection System.



AST

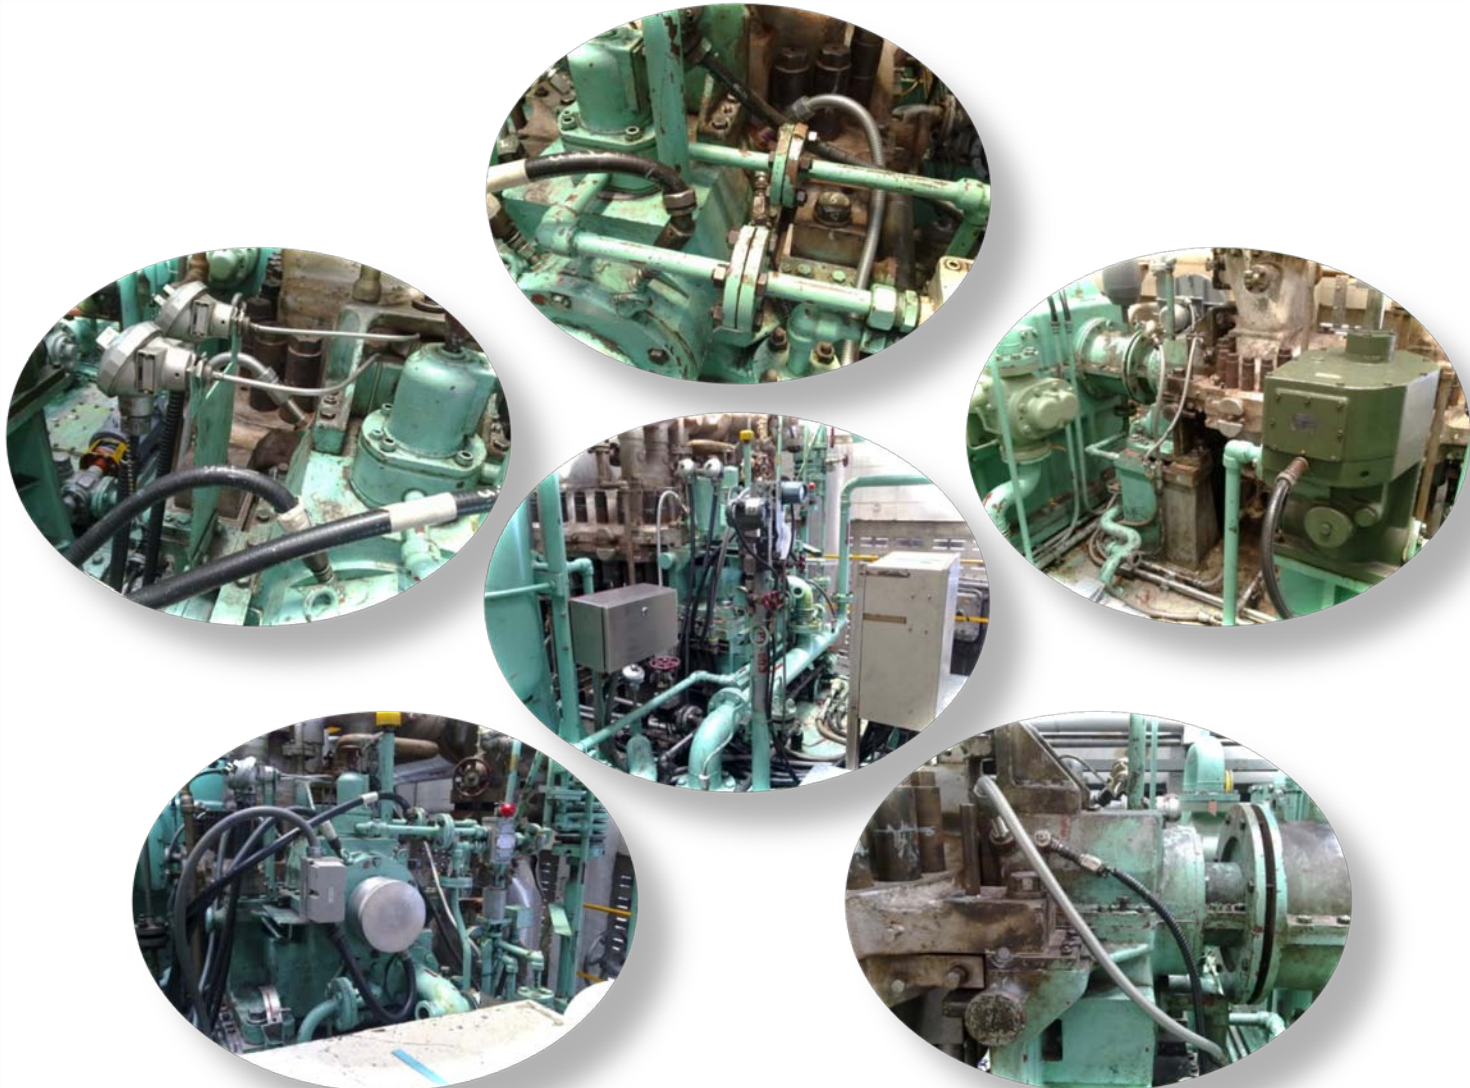



Most Valued Global Provider of Predictive Maintenance Solution

AST



Most Valued Global Provider of Predictive Maintenance Solution

AST

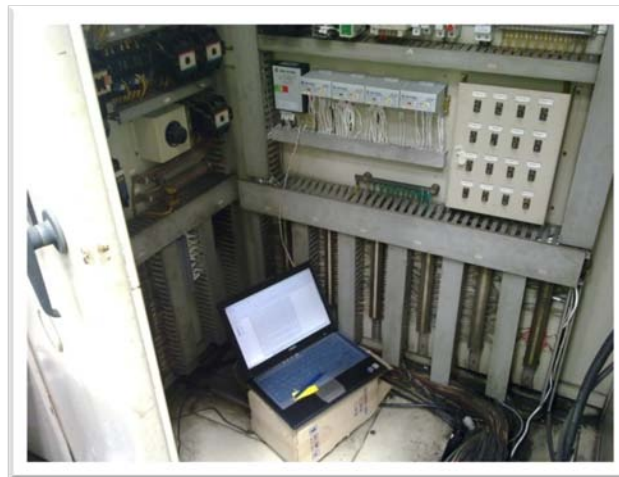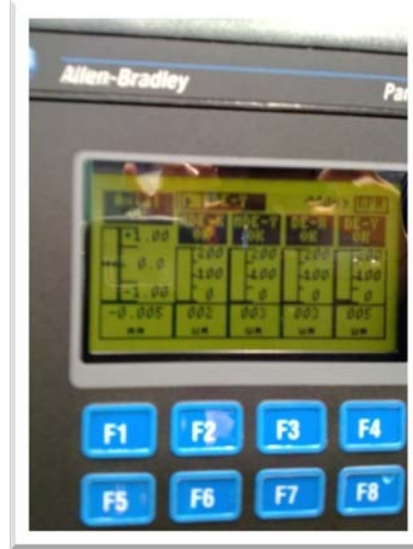

Most Valued Global Provider of Predictive Maintenance Solution



AST



Most Valued Global Provider of Predictive Maintenance Solution

